



NSAI
Agrément

CERTIFICATE NO. 09/0191

Warmfill Ltd., 8 Bangor Road,
Holywood, Co. Down BT18 0LQ.
Tel: (0044) 28 9042 8260 Fax: (0044) 28 9042 7641

E-mail: sales@warmfill.com
Website: www.warmfill.com

Warmfill Cavity Wall Insulation System

Isolent de murs à double paroi Kerndämmung

NSAI Agrément (Irish Agreement Board) is designated by Government to issue European Technical Approvals.

NSAI Agrément Certificates establish proof that the certified products are 'proper materials' suitable for their intended use under Irish site conditions, and in accordance with the **Building Regulations 1997 to 2008**.



Warmfill White Bead
 λ value = 0.04 W/(mK)



Warmfill Silver Bead
 λ value = 0.033 W/(mK)



Warmfill Super Silver Bead
 λ value = 0.031 W/(mK)

PRODUCT DESCRIPTION:

This Certificate relates to the Warmfill Cavity Wall Insulation System. Warmfill Cavity Wall Insulation is an expanded polystyrene material which is injected in bead form with a binding agent into the cavity walls. There are three types of bonded bead available:

- (i) Warmfill White, standard grade with a density of 12kg/m³
- (ii) Warmfill Silver graphite enhanced with a density of 12kg/m³ (colour = Light grey)
- (iii) Warmfill Super Silver, high λ value with a density of 11kg/m³ (colour = dark grey)

They are used to reduce the thermal transmittance of completed, new or existing cavity walls with masonry inner and outer leaves.

This Certificate certifies compliance with the requirements of the Building Regulations 1997 to 2008.

The product is used for the thermal insulation of new or existing masonry walls up to 12 meters in height, subject to the conditions contained in Part 3 of this Certificate. It also facilitates the control of surface and interstitial condensation in walls. The current Building Regulations requirements can be met with this product, as shown in Table 1.

MANUFACTURE AND MARKETING

The product is manufactured by
Warmfill Ltd., Unit 5, Redlands Road,
Port of Larne, BT 40 1Ax, Co. Antrim

and marketed by:
Warmfill Ltd., 8 Bangor Road,
Holywood, Co. Down BT18 0LQ.

Tel: (0044) 28 9042 8260
Fax: (0044) 28 9042 7641
E-mail: sales@warmfill.com
Website: www.warmfill.com

USE:

Readers are advised to check that this Certificate has not been withdrawn or superseded by a later issue by contacting the NSAI Agrément, NSAI, Santry, Dublin 9 or online at <http://www.nsai.ie/modules/certificates/uploads/pdf/IAB090191.pdf>

1.1 ASSESSMENT

In the opinion of the NSAI Agrément, Warmfill Cavity Wall Insulation if used in accordance with this certificate, can meet the requirements of the Building Regulations 1997 to 2008 as indicated in Section 1.2 of this Agrément Certificate.

1.2 BUILDING REGULATIONS 1997 to 2008

REQUIREMENT:

Part D - Materials and Workmanship

D3 – Warmfill Cavity Wall Insulation, as certified in this NSAI Agrément Certificate, is manufactured from materials which are 'proper materials' fit for their intended use (see Part 4 of this Certificate).

D1 – Warmfill Cavity Wall Insulation used in accordance with this NSAI Agrément Certificate, can meet the requirements for workmanship.

Part B – Fire Safety

B3 – Internal fire spread (Structure)

Warmfill Cavity Wall Insulation is combustible but may be used in masonry cavity walls in buildings of every purpose group (see Section 4.1 of this Certificate).

Part C – Site Preparation and Resistance to Moisture

C4 – Resistance to Weather and Ground Moisture

Warmfill Cavity Wall Insulation can meet the requirements, when installed in accordance with this Certificate in cavity walls constructed in compliance with the conditions indicated in Part 3. Warmfill Cavity Wall Insulation does not absorb water by capillary action and may be used in exposures as indicated in Section 3 of this Certificate, and in situations where insulation is placed below the damp-proof course (see Section 4.2 of this Certificate).

Part J – Heat Producing Appliances

J3 – Protection of Building

In the opinion of the NSAI Agrément, Warmfill Cavity Wall Insulation if used in accordance with this Certificate, can meet the requirements of Part J of the Building Regulations 1997 to 2008.

Part L – Conservation of Fuel and Energy

L1 – Conservation of Fuel and Energy

U value calculations may be based on a λ value =
0.040 W/(mK) for Warmfill White Bead
0.033 W/(mK) for Warmfill Silver Bead
0.031 W/(mK) for Warmfill Super Silver Bead

Walls using Warmfill Cavity Wall Insulation can meet the current U-value requirements in Full Fill Cavity Wall Insulation applications depending on the cavity width (see Table 1 – Section 4.4 of this Certificate).

2.1 PRODUCT DESCRIPTION

Warmfill Cavity Wall Insulation consists of an expanded polystyrene material injected in bead form with a binding agent. The binding agent is used to provide long-term stability to the insulant.

The Warmfill Cavity Wall Insulation System can be installed using an electric fan blowing system or a compressed air delivery system.

The current Building Regulation requirements can be met by installing this product (see Table 1). It should be noted that the construction of walls with cavities in excess of 110 mm requires adjustments to lintels, wall ties, cavity barriers etc. It is therefore necessary that cavity walls are adequately designed in respect of structural stability and fire safety in accordance with Parts A and B of the Building Regulations (see section 4.4 of this certificate).

Product Range

The polystyrene bead is delivered in a container and injected into the cavity with the binding agent. The target mean density for this product installed with the binding agent is 12 kg/m³ for the Warmfill White and Warmfill Silver systems and 11kg/m³ for Warmfill Super Silver. Local areas within the wall when sampled over an area of 0.5 m² may have density variations of ±2 kg/m³ for the system using the binding agent.

2.2 MANUFACTURE

Warmfill Cavity Wall Insulation is manufactured from expanded polystyrene bead as follows:

Warmfill White is manufactured from NOVA F21R with a nominal manufactured density of 2kg/m³ (colour = white).

Warmfill Silver is manufactured from BASF 2300 or NOVA S400R with a nominal manufactured density of 12kg/m³ (colour = light grey).

Warmfill Super Silver, is manufactured from Sunpor LAM753 GB with a nominal manufactured density of 11kg/m³ (colour = dark grey).

2.3 DELIVERY, STORAGE AND MARKING

The Warmfill Cavity Wall Insulation System is delivered to site in a sealed bulk container. The relevant delivery paperwork is marked with the NSAI Agrément identification mark incorporating the number of this Certificate and a unique batch number. The material, which has an indefinite storage life, should be kept dry.

The binding agent is also supplied to site in drums marked with the NSAI Agrément identification mark incorporating the number of this Certificate and a unique batch number. The binding agent should not be diluted or allowed to freeze and should be handled in accordance with the data sheet as outlined in the Warmfill Installation Manual

2.4 INSTALLATION PROCEDURE

2.4.1 Site Survey

A survey is carried out prior to installation by a trained CWI surveyor, acting on behalf of the Manufacturer/ Approved Installer who will ascertain the suitability of the property or properties for the Warmfill Cavity Wall Insulation System.

A complete survey (including a boroscope survey) report is prepared and held at the Approved Installer's offices. Particular problems are specifically identified and any reasons for rejection of the work are noted.

Quotations, tenders and invoices bear the NSAI Agrément identification mark incorporating the number of this Certificate.

2.4.2 Site Preparation

The installing operative ensures that the property has been correctly surveyed and is suitable for insulation with the Warmfill Cavity Wall Insulation System. Any problems encountered during drilling which prevent compliance with this Certificate are referred to the Certificate Holder before proceeding.



Warmfill White Bead
λ value = 0.04 W/(mK)



Warmfill Silver Bead
λ value = 0.033 W/(mK)



Warmfill Super Silver Bead
λ value = 0.031 W/(mK)

Essential ventilation openings such as those providing combustion air or under floor ventilation and all flues in the cavity wall are checked. If adequate sleeving or other cavity closures are not present, installation must not proceed until these openings have been sleeved or otherwise modified to prevent blockage by the insulant.

The tops of cavity walls must be closed. Cavity filling should not be carried out unless electrical cables are placed in conduits.

2.4.3 Approved Installers

Installation of the Warmfill Cavity Wall Insulation System is carried out by Warmfill Ltd. or by their Approved Installers who:

- 1) Are required to meet the requirements of an initial site installation check by NSAI Agrément prior to approval and are subject to the NSAI Agrément Surveillance Scheme.
- 2) Are approved by Warmfill Ltd. and NSAI Agrément to install the product.
- 3) Have undertaken to comply with the Warmfill Ltd. installation Procedure.
- 4) Are employing technicians who have been issued with appropriate identity cards by Warmfill Ltd. At least one member of each installation team must carry a card verifying this.
- 5) Are subject to supervision by Warmfill Ltd., including unannounced site inspections, in accordance with the NSAI Agrément Assessment/Surveillance Scheme.

2.4.4 Supervision

Installation should be carried out in accordance with the NSAI Agrément Surveillance Scheme.

During installation the following simple checks can be made, as an aid to determining that the installation conforms to the Certified method:

- 1) Check that the pattern of holes complies with the description given in Section 2.4 of this Certificate.
- 2) Check that the injection of the material takes place at each hole, to complete the filling of the cavity space.

2.4.5 Procedure

The Warmfill Cavity Wall Insulation System is installed using an approved electric fan lowing equipment or compressed air system marked with the appropriate NSAI Agrément Certificate number.

The installer provides all necessary hoses, drilling tools equipment and materials for making good the walls after the installation of the Warmfill Cavity Wall Insulation System.

Where a semi-detached or terraced property is to be insulated, the insulation is contained by inserting a cavity barrier at the line dividing the

properties. This consists of a nylon brush. After filling, the cavity barrier is retained in the cavity and the drill holes filled. The nylon brush can also be used to prevent the blocking of under floor vents with the blown bead where these have not been previously sleeved.

After completion of the cavity assessment and drilling plan for the building, preparation for injection into the cavity is as follows:

Holes of 22mm – 26mm diameter are drilled in the outer or inner leaf. They are normally spaced approximately 600 – 650 mm horizontally apart and the top row of holes in each wall is approximately 200 mm from the top of the wall. A similar series of holes is drilled below windows and obstructions and, if found to be necessary, along the lines of the roof slope at gable ends. Alternatively, a series of holes is drilled approximately 600 – 650 mm horizontally apart and 200 mm above the highest ceiling level. A further series of holes 2.0 m apart is drilled at the middle height of a two storey building to ensure complete fill of the cavity space. Care should be taken to ensure that these holes do not coincide with the intermediate suspended timber floor. A typical drilling pattern is shown in Figure 1.

The product is injected into the cavity with the correct material binder ratio through a flexible pipe fitted with a non-directional nozzle. The material packs to a uniform density in the cavity and this is not affected by the injection equipment. Holes beneath ground-floor windows are injected first and filling then continues upwards until a complete fill has been achieved.

After injection, the wall is made good to match the existing finish as closely as possible. All the trunked air vents are checked, e.g. those providing underfloor ventilation and combustion air for heating appliances. In all cases flues are carefully checked on completion of the installation by means of an appropriate test (e.g. a smoke test) to ensure they are not obstructed by the insulant.

Any insulant that has been blown through the top of the cavity into the loft space is removed and any points of leakage sealed.

Prior to the commencement of the filling operation it is important that the flow rates of the blowing bead and adhesive are checked. This is carried out by filling a hessian bag with dry bead for 60 seconds, the bead is weighed and weight recorded. Using the bead/flow chart the correct amount of adhesive is applied to the bead to ensure adequate binding of the product in accordance with the Warmfill Manuals.

3 GENERAL

- 3.1** The Warmfill Cavity Wall Insulation System, when installed in accordance with this Certificate, is effective in reducing the 'U' value (thermal transmittance) of external masonry cavity walls, using clay or calcium silicate bricks, concrete blocks, natural stone or reconstituted stone masonry units. It is essential that such walls are designed and constructed to prevent moisture penetration and in accordance with the Building Regulations.
- 3.2** As with all cavity wall insulation, the construction detailing of the building where the insulation is to be installed should comply with good practice. Certification will only relate to buildings which conform to the design conditions set out here and to buildings where the Certificate Holder or Registered Installer has carried out a complete assessment, including a boroscope survey, and has given written approval for the use of the product.
- 3.3** Cavity walls with the outer leaf constructed using unrendered (fair-faced) block work are not suitable for full-fill cavity wall insulation. They are therefore not covered by this Certificate.
- 3.4** There are separate procedures for assessing suitability of existing and new buildings for Warmfill insulation.
- 3.5** Existing buildings should be assessed in accordance with BS 8208: Part 1:1985 *Guide for the assessment of suitability of external cavity walls, for filling with thermal insulants – Existing traditional cavity construction*. Existing Buildings are defined as buildings of at least three years old.
- 3.6** For new buildings, the designer selects a construction appropriate to the local wind-driven rain index, paying due regard to the design, detailing, workmanship and materials to be used.
- 3.7** Buildings subject to the relevant requirements of the Building Regulations 1997 to 2008 should be constructed in accordance with IS 325:Part 1:1986 *Code of Practice for the use of Masonry - Structural Use of Unreinforced Masonry*, and IS 325:Part 2:1995 *Code of Practice for the use of masonry - Masonry construction*. Where reinforced masonry is involved, the design should be in accordance with BS 5628: Part 2:2005 *Code of practice for use of masonry, Structural use of reinforced and prestressed masonry*. The relevant recommendations of Section 3 of BS 5390:1976 *Code of practice for stone masonry* should be followed where the wall incorporates stone or cast stone.
- In the case of fair faced brickwork only tool flush joint brickwork is acceptable, subject to the following conditions:
- The minimum cavity width for existing buildings is 40 mm;
 - There are no signs of dampness on the inner face of the cavity other than those caused solely by condensation.
- 3.8** Any defects recorded which may affect the performance of the installed insulation system must be rectified to the satisfaction of the Approved Installer before work commences.
- 3.9** In cavities where electric cables can come into contact with expanded polystyrene, in accordance with good construction practice all PVC sheathed electric cables should be run through ducting.
- 3.10** Warmfill Cavity Wall Insulation is capable of contributing to or exceeding the 'U' value of 0.27W/m²K required in the Building Regulations (See Table 1).
- 3.11 Assessment of Exposure Zones**
During the assessment phase of a building for cavity wall insulation the topography factor of the site must be taken into account in all exposure zones. The topography factor takes account of local features such as hills, cliffs, escarpments or ridges where dwellings are located, which can significantly affect the wind speed in their vicinity. It should be derived for each wind direction considered. Reference should be made to BS 8104:1992 *Code of practice for assessing exposure of walls to wind driven rain*) for guidance in this regard. Appendix C makes reference to the topography factor which details the method of calculation of the wind driven rain index for exposed sites in all zones. It is only after all relevant factors are considered and calculations carried out can a true assessment of the work content for a particular building be arrived at. Figure 2 identifies the two exposure zones for wind driven rain appropriate to this certificate as follows:
- 3.11.1 Normal Exposure**
Normal exposure to wind-driven rain applies in districts where the driving rain index is less than 5m²/sec/year however, some areas may require modification to calculations in order to cater for particular individual sites where the topography of a site warrants it (see Figure 2). Appendix C of BS 8104:1992 together with information provided by the Irish Meteorological Office should be consulted.

In **normal exposure** areas the types of outer leaf masonry finishes and zones where the Warmfill Cavity Wall Insulation System is suitable are as follows:

- Impervious cladding and rendered walls with a minimum cavity width of 90 mm and up to 12m in height, and
- Fair faced unrendered brickwork with tooled flush joints up to two storeys in height with a minimum cavity width of 90mm and up to three storeys in height with a minimum cavity width of 110mm.

3.11.2 Severe Exposure

Severe exposure to wind-driven rain applies in districts where the driving rain index is $5\text{m}^2/\text{sec}/\text{year}$ or greater (see Figure 2). During the pre-insulation survey of any particular building, due regard to the exposure zones and type of masonry construction must be assessed prior to the commencement of the installation process.

In **severe exposure** areas the type of outer leaf masonry finish where the Warmfill Cavity Wall Insulation System is suitable is:

- Impervious cladding and rendered walls with a minimum cavity width of 90mm and up to 12m in height.

Unrendered brickwork is not suitable for full-fill cavity wall insulation in the severe exposure zones.

Weep holes in accordance with good construction practice must be provided at the base of brick faced cavity walls at 450mm centres and over lintels.

3.12 In both new and existing buildings, whenever practicable, all of the cavity space from ground level to roof or gable copings must be filled. Partial filling is only allowed in the following situations:

- 1) When separately insulating semi-detached or terraced properties. The type of cavity barrier used for this purpose must be as defined in Section 2.4.5 of this Certificate.
- 2) Up to the underside of a horizontal boundary, other than the roof, where that boundary is protected by a cavity tray or similar waterproof barrier which must not be distorted or damaged by the installation process.
- 3) Where filling is carried out above a horizontal boundary where that boundary is protected by a cavity tray or similar waterproof barrier which must not be distorted or damaged by the installation process.
- 4) When treating properties where the wall to be insulated is below a waterproof cladding (e.g. tile hung) and this cladding either extends up to the roof or is protected at the top by other means (e.g. window sills with adequate waterproof barrier system).
- 5) Where it is established that the roof void will not be an occupied space, and where the attic insulation is provided at ceiling level, partial filling of the gable apex (i.e. limiting the fill to at least 200mm above ceiling level insulation) may be permitted provided the top of the gable apex is adequately protected by the roof and its overhang and where the attic space is adequately ventilated.

3.13 Structures

The spacing of wall ties should be installed in accordance with Table 9a of IS 325: Part 2:1995. When the cavity width exceeds 110mm the wall and foundations should be designed by a Structural Engineer in accordance with IS 325: Part 1:1986.

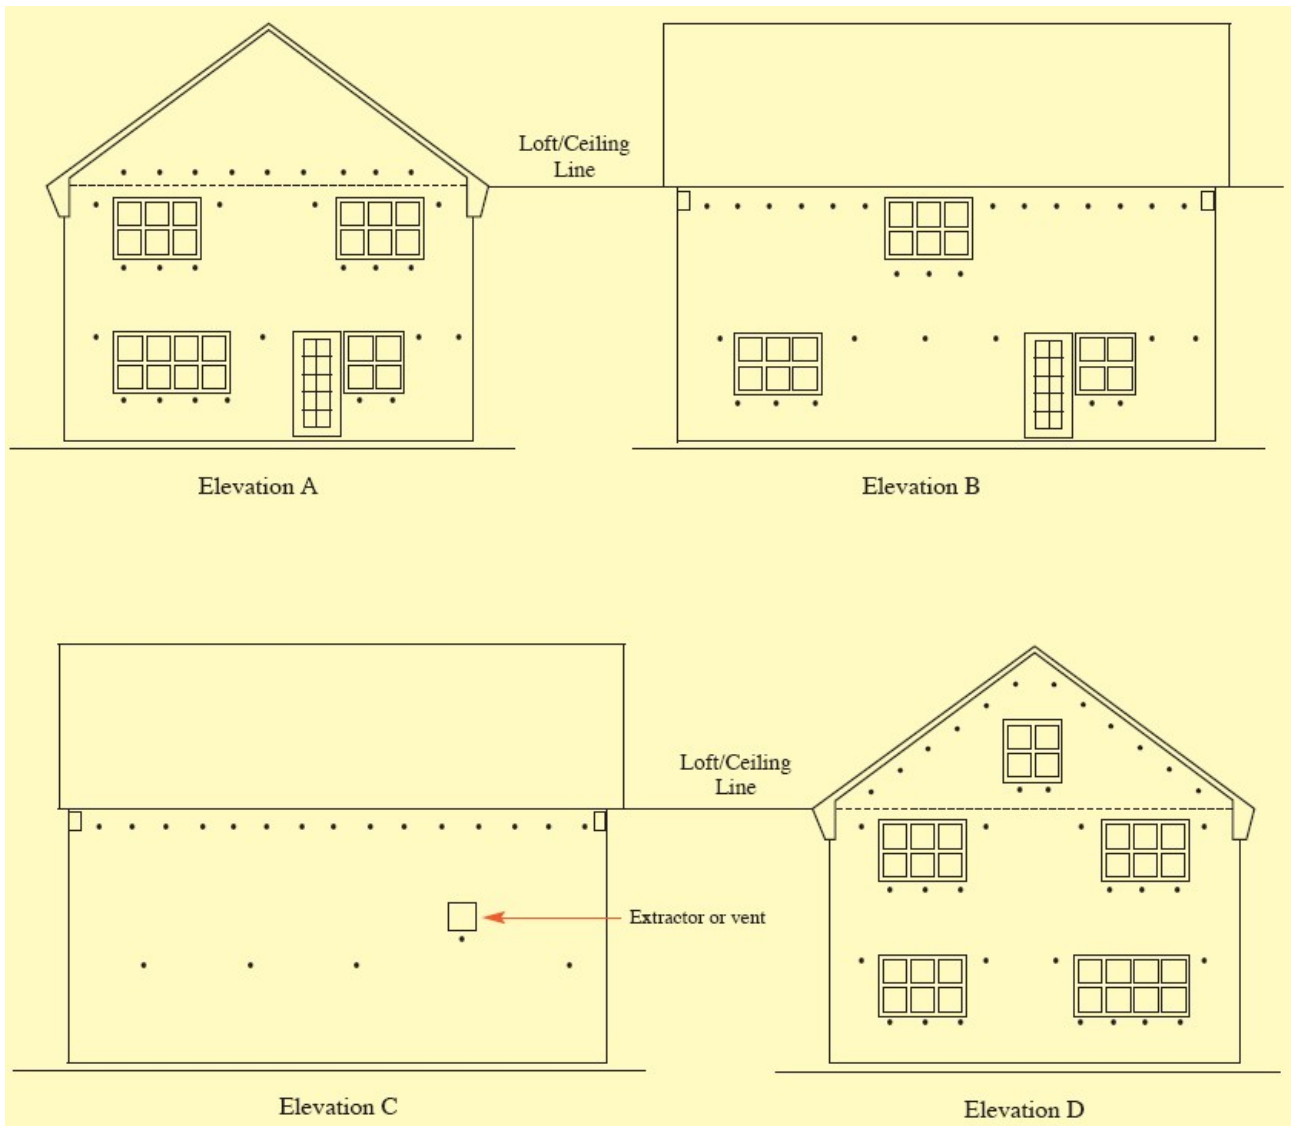


Figure 1: Typical Warmfill Hole Drilling Pattern in a Detached Dwelling

Driving Rain Map

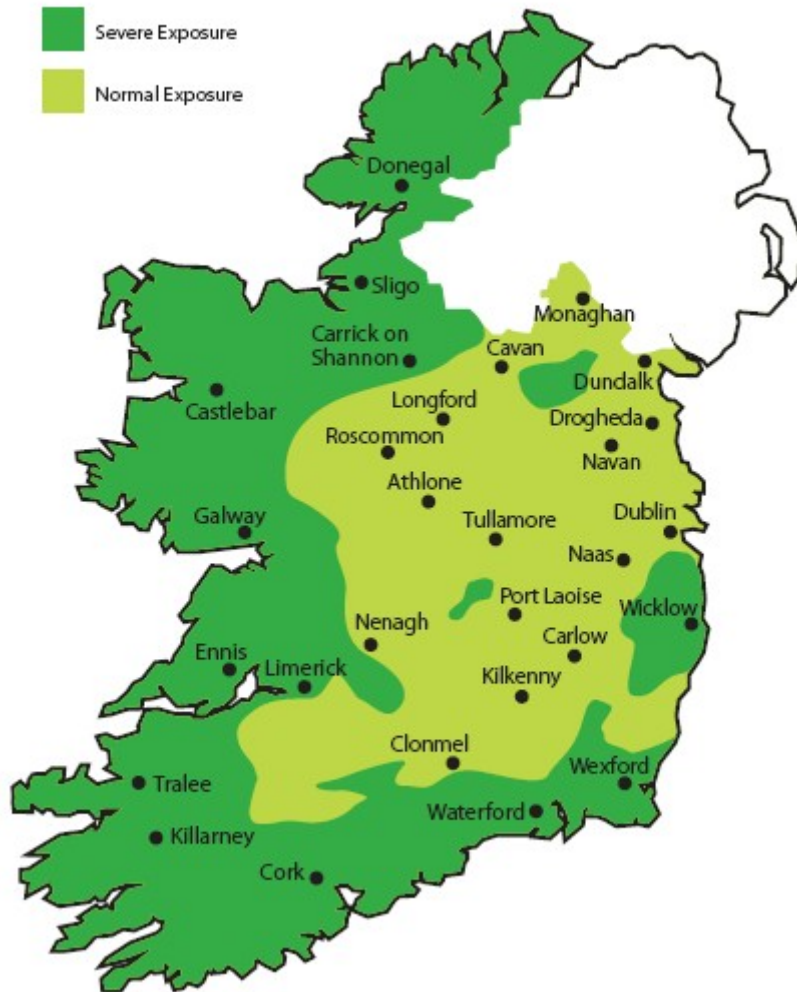


Figure 2: Driving Rain Map
(Indicative only – Not to scale)

4.1 BEHAVIOUR IN FIRE

4.1.1 The use of the product does not prejudice the fire resistance properties of the wall. It is unlikely to become ignited within the cavity when used in the context of this Certificate. If fire does penetrate into the cavity, the amount of air present will be insufficient to support combustion. However, the directions contained in this Certificate relating to the sealing of an uncapped cavity and removing insulant present in the loft space after installation must be carefully followed.

When using this product, the requirements of the Building Regulations 1997 to 2008 relating to fire spread in cavity walls can be met in most purpose groups without the need for cavity barriers provided the walls are constructed in accordance with the following provisions of the TGD to Part B Fire:

1. The wall must consist of masonry inner and outer leaves, each at least 75 mm thick.
 2. The cavity must be closed at the top of the wall and at the top of any opening.
 3. In addition to the product only the following combustible materials shall be placed in, or exposed to, the cavity:
 - a) timber lintel, window or door frame, or end of timber joist
 - b) pipe, conduit
 - c) dpc flashing closer or wall tie
 - d) domestic meter cupboard, provided that:
 - there are not more than two cupboards to a dwelling.
 - the opening in the outer leaf is not more than 800 mm by 500 mm for each cupboard, and
 - the inner leaf is not penetrated except by a fire-stopped sleeve not more than 80 mm by 80 mm.
 - e) thermal insulating material
 - f) in respect of purpose groups 3 – 8 the cavities are sub-divided so that the distance between cavity barriers does not exceed the dimensions given in paragraph 3.3 of the TGD to Part B
- 4.1.2** For buildings constructed in accordance with the Building Regulations 1997 to 2008 the product may be used in buildings of every purpose group.
- 4.1.3** As the Warmfill Cavity Wall Insulation System material is manufactured without the use of 'CFCs', or similar gases, there is no release of such gas on burning.
- 4.1.4 Protection of Buildings**
Combustible wall insulation material should be separated by solid non-combustible material not less than 200mm thick, from any heating appliance or from any flue pipe or opening to a heating appliance; alternatively it should be separated by 40mm from the outer surface of a

masonry chimney. Particular details are given in Diagrams 2-8 of the TGD Part J Building Regulation 1997 to 2008. For factory made insulated chimneys, separation between this product and the external surface of the chimney shall be determined in accordance with Clause 2.17, of Part J of the Building Regulations 1997 to 2008.

4.2 LIQUID WATER PENETRATION

- 4.2.1** Test data obtained by NSAI Agrément confirms that a masonry wall incorporating the Warmfill Cavity Wall Insulation System and built to the requirements of IS 325:Part 1:1986, will not transmit water to the inner leaf.
- 4.2.2** Test data obtained by the NSAI Agrément also demonstrates that the Warmfill Cavity Wall Insulation System material does not absorb water by capillary action. Water which penetrates the outer leaf of the wall will drain down the cavity face of the outer leaf. When the product is used in situations where it bridges the dpc in walls, dampness from the ground will not pass through, provided the cavity is taken down to at least 150 mm below the level of the lowest dpc.
- 4.2.3** The Warmfill Cavity Wall Insulation System, when used in accordance with this Certificate, presents no significant risk of water penetration.
- 4.3 WATER VAPOUR PENETRATION AND CONDENSATION RISK**
The Warmfill Cavity Wall Insulation System is not a water vapour barrier.
- 4.4 THERMAL INSULATION**
The thermal conductivity 'λ' value' of the Warmfill Cavity Wall Insulation System material may be taken as:
0.040 W/(mK) for Warmfill White Bead
0.033 W/(mK) for Warmfill Silver Bead
0.031 W/(mK) for Warmfill Super Silver Bead

The required maximum U-values for external walls can be obtained in typical cavity wall constructions as indicated in Table 1.

4.5 DURABILITY

The Warmfill Cavity Wall Insulation System is rot-proof, water repellent and durable. When installed in accordance with this certificate it is sufficiently stable to prevent settlement and will remain effective as an insulant for the life of the building when installed in accordance with this Certificate.

Should it ever become necessary for whatever reason, to remove the material from the cavity void, Warmfill Cavity Wall Insulation can be evacuated from the cavity void.

4.6 TESTS AND ASSESSMENTS WERE CARRIED OUT TO DETERMINE THE FOLLOWING:

- efficiency of fill using specified equipment and drilling pattern
- density of fill
- water resistance of filled cavity
- water uptake
- thermal conductivity

4.7 OTHER INVESTIGATIONS

- Existing data on product properties in relation to fire, toxicity, environmental impact and the effect on structural stability and durability were assessed. The absence of chloro-fluorocarbon gases 'CFCs' was established by test.
- The manufacturing process was examined including the methods adopted for quality control, and details were obtained of the quality and composition of the materials used.
- A site visit was conducted to assess the practicability of installation.
- Driving rain resistance was assessed.
- A condensation risk analysis was performed.

Standard white bead 0.04 W/mK																	
Brick 1700 kg/m³ / Block 2000 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.59	0.55	0.52	0.48	0.45	0.43	0.40	0.39	0.37	0.35	0.34	0.32	0.31	0.30	0.29	0.28	0.27
Block 2000 kg/m³ (Rendered) / Block 2000 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.60	0.56	0.52	0.49	0.46	0.43	0.41	0.39	0.37	0.35	0.34	0.32	0.31	0.30	0.29	0.28	0.27
^{1/} Brick 1700 kg/m³ / Block 650 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.46	0.44	0.41	0.39	0.37	0.36	0.34	0.33	0.32	0.30	0.29	0.28	0.27	0.27	0.26	0.26	0.25
Warmfill Silver bead 0.033 W/mK																	
Brick 1700 kg/m³ / Block 2000 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.51	0.47	0.44	0.41	0.39	0.37	0.35	0.33	0.31	0.30	0.29	0.27	0.26	0.25	0.24	0.24	0.27
Block 2000 kg/m³ (Rendered) / Block 2000 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.52	0.47	0.44	0.41	0.39	0.37	0.35	0.33	0.31	0.30	0.29	0.27	0.26	0.25	0.24	0.24	0.23
^{1/} Brick 1700 kg/m³ / Block 650 kg/m³ / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.43	0.40	0.38	0.36	0.34	0.32	0.31	0.30	0.28	0.27	0.26	0.25	0.24	0.23	0.23	0.22	0.21
Warmfill Super Silver Bead 0.031 W/mK																	
Brick 1700 kg/m³ / Block 2000 kg/m³ / Plaster																	
mm	50	60	70	80	90	100	110	120	130	140	150						
U	0.50	0.43	0.38	0.33	0.30	0.27	0.25	0.23	0.22	0.20	0.19						
Brick 1800 kg/m³ (Rendered) / Block 2000 kg/m³ / Plaster																	
mm	50	60	70	80	90	100	110	120	130	140	150						
U	0.48	0.42	0.37	0.33	0.30	0.27	0.25	0.23	0.22	0.20	0.19						
^{1/} Block 2000 kg/m³ (Rendered) / Block 650 kg/m³ / Plaster																	
mm	50	60	70	80	90	100	110	120	130	140	150						
U	0.40	0.35	0.32	0.29	0.26	0.24	0.23	0.21	0.20	0.19	0.17						

Table 1: External Walls – Estimated U Values W/(m²K)

The construction of walls with cavities in excess of 110mm wide requires adjustments to lintels, wall ties, cavity barriers, etc. It is therefore necessary that cavity walls are adequately designed in respect of structural stability and fire safety in accordance with Parts A and B of the Building Regulations. For Table 1 it is assumed that cavity walls containing full-fill bonded bead will be constructed in accordance with the requirements of the 1997 to 2008 Building Regulations.

^{1/} Calculated U value on wall constructed with inner leaf of 650 kg/m³ IAB Certified blocks (λ value = 0.17 W/mK)


- 5.1** National Standards Authority of Ireland ("NSAI") following consultation with the NSAI Agrément has assessed the performance and method of installation of the product/process and the quality of the materials used in its manufacture and certifies the product/process to be fit for the use for which it is certified provided that it is manufactured, installed, used and maintained in accordance with the descriptions and specifications set out in this Certificate and in accordance with the manufacturer's instructions and usual trade practice. This Certificate shall remain valid for five years from date of issue so long as:
- (a) the specification of the product is unchanged.
 - (b) the Building Regulations 1997 to 2008 and any other regulation or standard applicable to the product/process, its use or installation remains unchanged.
 - (c) the product continues to be assessed for the quality of its manufacture and marking by NSAI.
 - (d) no new information becomes available which in the opinion of the NSAI, would preclude the granting of the Certificate.
 - (e) the product or process continues to be manufactured, installed, used and maintained in accordance with the description, specifications and safety recommendations set out in this certificate.
 - (f) the registration and/or surveillance fees due to NSAI Agrément are paid.
- 5.2** The NSAI Agrément mark and certification number may only be used on or in relation to product/processes in respect of which a valid Certificate exists. If the Certificate becomes invalid the Certificate holder must not use the NSAI Agrément mark and certification number and must remove them from the products already marked.
- 5.3** In granting Certification, the NSAI makes no representation as to;
- (a) the absence or presence of patent rights subsisting in the product/process; or
 - (b) the legal right of the Certificate holder to market, install or maintain the product/process; or
 - (c) whether individual products have been manufactured or installed by the Certificate holder in accordance with the descriptions and specifications set out in this Certificate.
- 5.4** This Certificate does not comprise installation instructions and does not replace the manufacturer's directions or any professional or trade advice relating to use and installation which may be appropriate.
- 5.5** Any recommendations contained in this Certificate relating to the safe use of the certified product/process are preconditions to the validity of the Certificate. However the NSAI does not certify that the manufacture or installation of the certified product or process in accordance with the descriptions and specifications set out in this Certificate will satisfy the requirements of the Safety, Health and Welfare at Work Act, 2005, or of any other current or future common law duty of care owed by the manufacturer or by the Certificate holder.
- 5.6** The NSAI is not responsible to any person or body for loss or damage including personal injury arising as a direct or indirect result of the use of this product or process.
- 5.7** Where reference is made in this Certificate to any Act of the Oireachtas, Regulation made thereunder, Statutory Instrument, Code of Practice, National Standards, Manufacturer's instructions, or similar publication, it shall be construed as reference to such publication in the form in which it is in force at the date of this Certification.

NSAI Agrément

This Certificate No. **09/0191** is accordingly granted by the NSAI to **Warmfill Ltd.** on behalf of NSAI Agrément.

Date of original Issue: **October 2003**

Signed



Revision dated June 2009: Addition of the Warmfill Super Silver Bead and other general changes

Seán Balfe
Director of the Irish Agrément Board

Readers may check that the status of this Certificate has not changed by contacting NSAI Agrément, NSAI, 1 Swift Square, Northwood, Santry, Dublin 9, Ireland. Telephone: (01) 807 3800. Fax: (01) 807 3842. www.nsai.ie